




## WRONG LOCATION TO SET METER POLE

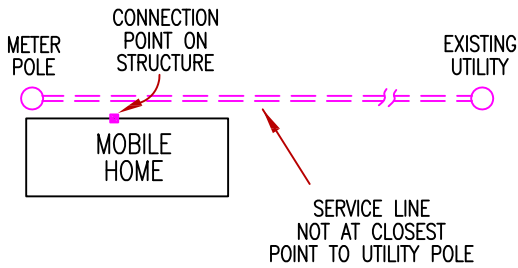


## CORRECT LOCATION OF METER POLE

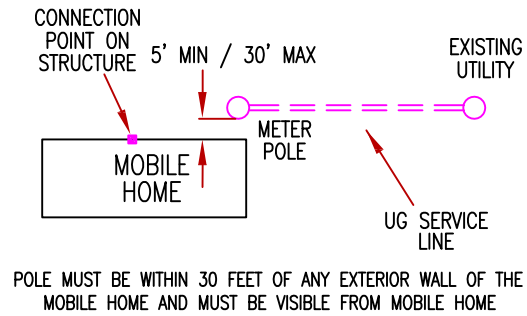


## WRONG LOCATION TO SET METER POLE

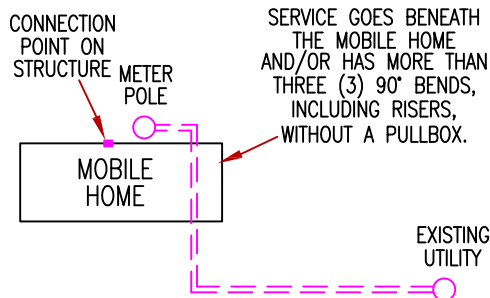


## CORRECT LOCATION OF METER POLE

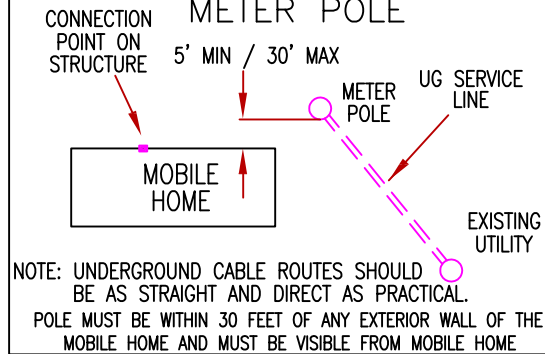

## METER CLEARANCES

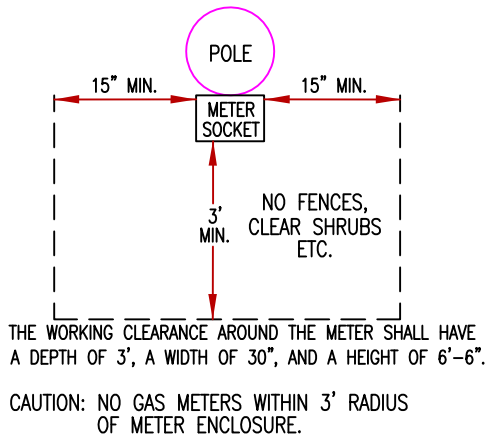

## CLEARANCE FROM POWER LINES TO MOBILE HOME

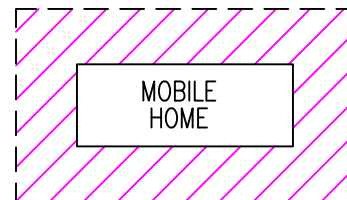

15 FOOT BOUNDARY LINE TO NEAREST SPEPA POWER LINE MEASURED HORIZONTALLY. THE ONLY LINES THAT MAY ENTER THIS ZONE IS THE SERVICE LINE TO THE METER POLE.

NO ELECTRIC WIRES ARE PERMITTED TO CROSS OVER MOBILE HOME. MOBILE HOMES ARE NOT PERMITTED TO BE INSTALLED UNDER ELECTRIC LINES.

LOCAL CODE AUTHORITIES MAY HAVE REQUIREMENTS IN ADDITION TO THOSE SHOWN.



METER POLE LOCATION FOR  
UNDERGROUND SERVICE  
TO MOBILE HOME

DATE	REVISION	DRAWN	CHECK	DATE	FILE NAME
08/18/16	CHANGED COMPANY LOGO	CLJ	JLJ	JAN. 2016	LOCATION UG TO MP
		SCALE		SHEET	ASSEMBLY
		NOT TO SCALE		1 OF 1	N/A