



**OPTION: 1**

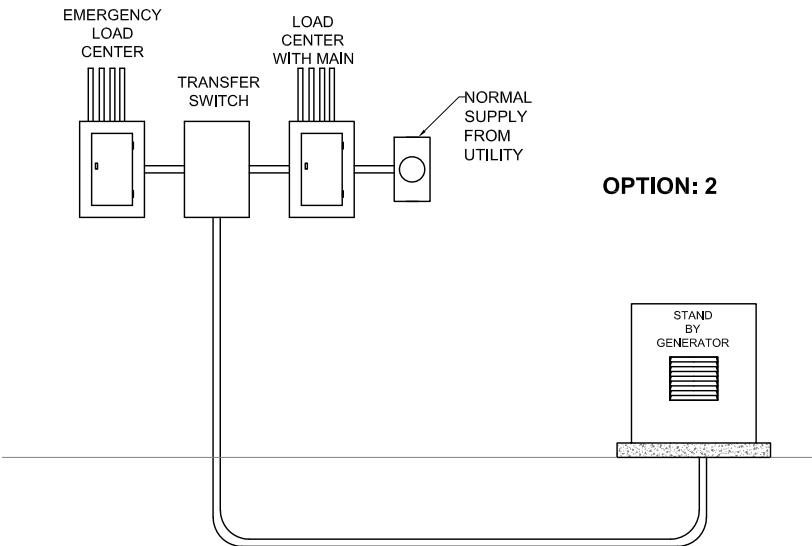


**OPTION: 2**

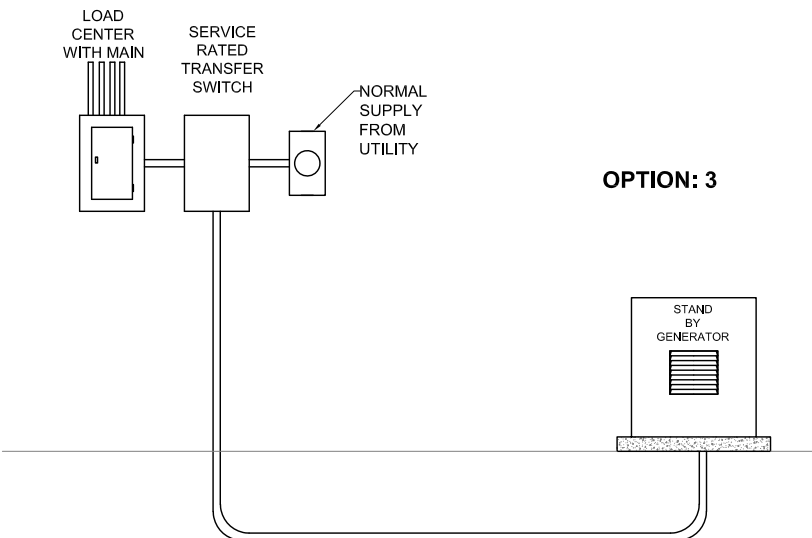

**OPTION: 3**

**NOTE:**  
 1. OPTION 1, 2, OR 3 ARE TYPICAL TRANSFER SWITCH CONFIGURATIONS.  
 2. DRAWING IS GUIDANCE FOR COMPLIANCE AND UTILITY EXPECTATIONS. THE NATIONAL ELECTRICAL CODE AND/OR LOCAL AUTHORITIES MAY HAVE ADDITIONAL REQUIREMENTS TO THOSE SHOWN. THE MORE STRINGENT REQUIREMENTS WILL TAKE PRECEDENCE FOR DIFFERENCES BETWEEN AUTHORITIES.

 <b>SOUTHERN PINE ELECTRIC</b>			
<b>TRANSFER SWITCH OPTIONS FOR STANDBY GENERATOR</b>			
DRAWN CLJ	CHECK RHM	DATE 10/04/18	FILE NAME TRANB_SV_SCH_BACKUP_GEN.DWG
SCALE NOT TO SCALE	SHEET 1 OF 1	ASSEMBLY N/A	